



GENERAL NOTES	KEYED NOTES
1. REFER TO DRAWING EO.1 FOR ELECTRICAL GENERAL NOTES, GENERAL DEMOLITION NOTES, LEGEND AND ABBREVIATIONS. REFER TO DRAWING E5.1 FOR PARTIAL POWER RISER DIAGRAM AND PANELBOARD SCHEDULES.	1) FURNITURE MOUNTED POWER/COMMUNICATION OUTLET. COORDINATE WITH ARCHITECT FOR EXACT LOCATION AND MOUNTING HEIGHT PRIOR TO INSTALLATION.
2. IN SCOPE OF WORK AREA, ALL ELECTRICAL DEVICES SHOWN WITH A SUBSCRIPT LETTER "E" ARE EXISTING TO REMAIN AND WITH OR WITHOUT "N" ARE NEW TO BE PROVIDED.	FOR ELECTRIC HAND DRYER. RUN 2#10 + 1# 10G. IN 3/4" C. TO PANEL INDICATED. SEE ARCHITECTURAL DRAWINGS FOR EXACT LOCATION AND EQUIPMENT HEIGHT PRIOR TO ROUGH—IN AND WIRING.
 PROVIDE NEW BRANCH CIRCUIT WIRING AS SHOWN TO ACCOMMODATE NEW CONSTRUCTION. REFER TO ARCHITECTURAL DRAWINGS, ELEVATION AND DETAILS FOR EXACT LOCATION OF ELECTRICAL DEVICES. REFER TO MECHANICAL AND PLUMBING DRAWINGS FOR EXACT MECHANICAL AND PLUMBING EQUIPMENT LOCATIONS. 	JUNCTION BOX FOR EWC. RECONNECT TO THE EXISTING CIRCUIT. CONTRACTOR TO TRACE EXISTING CIRCUIT & REPLACE EXISTING BREAKER TO GFI C.B. 4 NEW OUTLET AT EXISTING LOCATION OF EXISTING OUTLET TO BE REPLACED. RECONNECT THE EXISTING CIRCUIT IN PLACE. 5 JUNCTION BOX POWER CONNECTION TO TOILETS FLUSH & SINK SENSORS. PROVIDE FINAL CONNECTION TO EACH UNIT AS REQUIRED. 6 JUNCTION BOX UNDER COUNTER FOR GARBAGE DISPOSER (2HP-208V,1ø). AND MANUAL CONTROL SWITCH, MOUNTING @ 42"
	AFF. COORDINATE WITH ARCHITECT FOR EXACT LOCATION, MOUNTING HEIGHT AND CONTROL REQUIREMENTS PRIOR TO INSTALLATION. 7 RECEPTACLE FOR REACH—IN REFRIGERATOR. COORDINATE WITH EQUIPMENT VENDOR FOR EXACT NEMA CONFIGURATION PRIOR TO INSTALLATION 8 RECEPTACLE FOR ICE MAKER. COORDINATE WITH EQUIPMENT VENDOR FOR EXACT NEMA CONFIGURATION PRIOR TO INSTALLATION. 9 UNLESS OTHERWISE NOTED, ALL EXISTING ELECTRICAL & TELECOM DEVICES IN THIS ROOM ARE TO REMAIN IN PLACE.
	TO FINAL COORDINATION WITH ARCHITECT AND AV VENDOR FOR ALL WIRING REQUIREMENTS FROM ALL TV LOCATIONS TO THE MANAGER OFFICE.

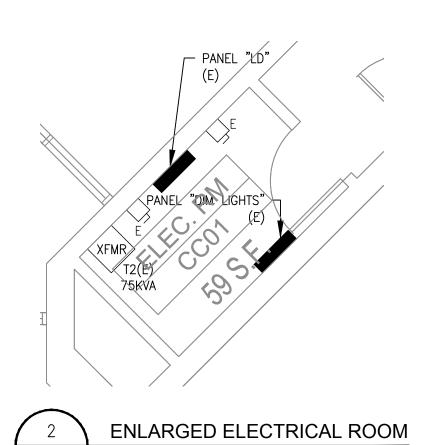

UNLESS OTHERWISE NOTED ALL ELECTRICAL DEVICES SHOWN ON PLAN ARE NEW TO BE PROVIDED.

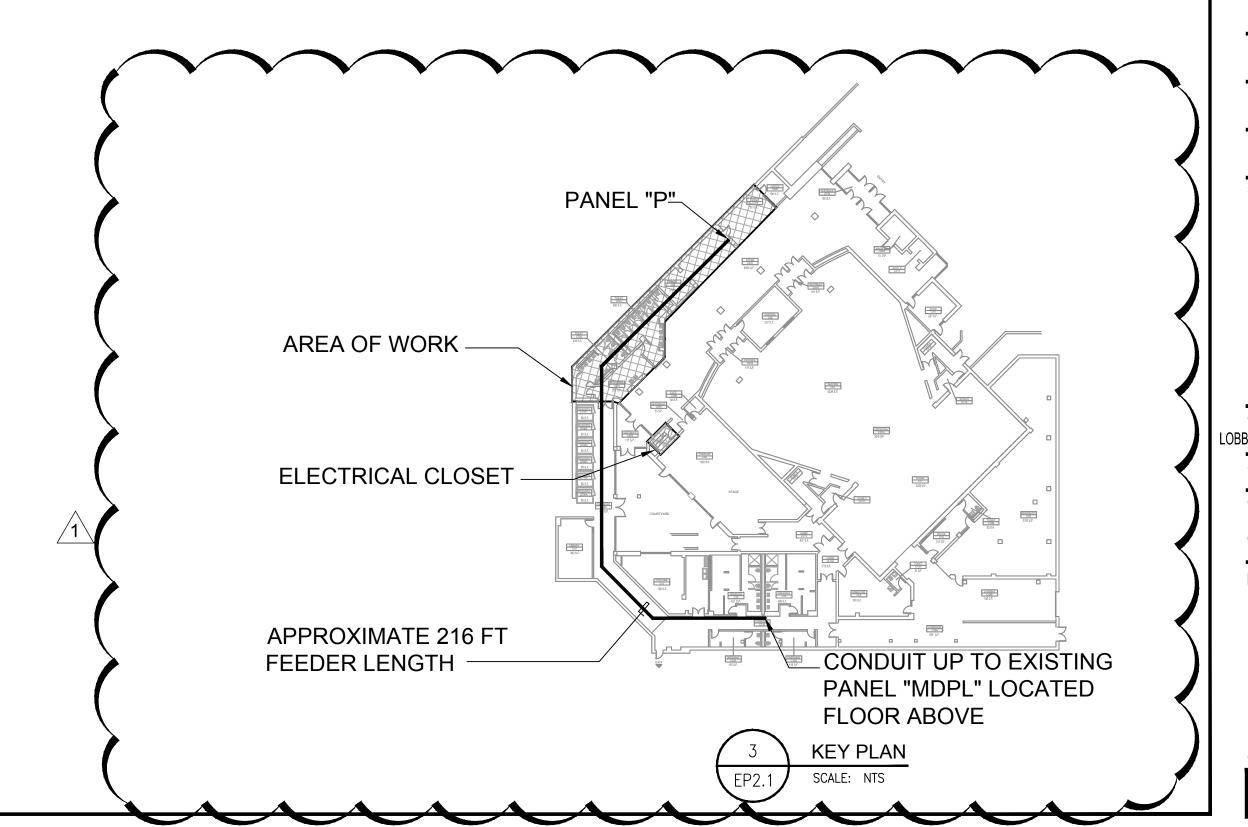

University of the **District of Columbia**

PROJECT GF-2010-C-0015

RENOVATION OF RESTROOMS AND DRESSING ROOMS AT THE CAMPUS AUDITORIUM BUILDING 46E OF THE

architect:



VAN NESS CAMPUS, UDC

3812 Van Ness Street NW Washington, DC 20016 phone 202.249.2901 fax 202.249.2902

building envelope engineers:

Washington, DC 20036

m.e.p. engineers:

phone 202.239.4199 fax 202.239.4198

setty and associates, intl., pllc 5185 MacArthur Blvd.Suite 106 Washington, DC 20016 phone 202.393.1523 fax 202.315.3059

specifications:

11 DuPont Circle NW, Suite 601 Washington, DC 20036 phone 202.364.2222 fax 202.234.5502

cost estimating:

Advanced Engineering Design, Inc. 6525 Belcrest Road, Suite 521 Hyattsville, MD 20782 phone 301.683.2110 fax 240.465.0653

100% Submission 08.03.2012

Final Submission 10.31.2012

/1 Amendment 2 01.07.2013

drawing title: LOBBY & RESTROOM - POWER PLAN - NEW WORK

checked by: project number:

04.16.2012