

AMENDMENT OF SOLICITATION/MODIFICATION OF CONTRACT			1. Contract Number	Page of Pages	
				1	7
2. Amendment/Modification Number	3. Effective Date	4. Requisition/Purchase Request No.		SEAS Laboratory Renovation Project, Building 32/42 - Storefront and Window Replacement	
GF-2014-B-0218-002	August 27, 2014				
6. Issued By: University of the District of Columbia Capital Procurement Division 4200 Connecticut Avenue, NW Building 38, C04 Washington, DC 20008		Code	7. Administered By (If other than line 6) University of the District of Columbia Capital Procurement Division 4200 Connecticut Avenue, NW Building 38, Room C04 Washington, DC 20008		
8. Name and Address of Contractor (No. Street, city, country, state and ZIP Code)			(X)	9A. Amendment of Solicitation No. GF-2014-B-0218	
				9B. Dated (See Item 11) August 8, 2014	
				10A. Modification of Contract/Order No.	
				10B. Dated (See Item 13)	
Code	Facility				
11. THIS ITEM ONLY APPLIES TO AMENDMENTS OF SOLICITATIONS					
<input checked="" type="checkbox"/> The above numbered solicitation is amended as set forth in Item 14. The hour and date specified for receipt of Offers <input type="checkbox"/> is extended. <input checked="" type="checkbox"/> is not extended. Offers must acknowledge receipt of this amendment prior to the hour and date specified in the solicitation or as amended, by one of the following methods: (a) By completing items 8 and 15, and returning <u>1</u> copy of the amendment; (b) By acknowledging receipt of this amendment on each copy of the offer submitted; or (c) By separate letter or fax which includes a reference to the solicitation and amendment number. FAILURE OF YOUR ACKNOWLEDGEMENT TO BE RECEIVED AT THE PLACE DESIGNATED FOR THE RECEIPT OF OFFERS PRIOR TO THE HOUR AND DATE SPECIFIED MAY RESULT IN REJECTION OF YOUR OFFER. If by virtue of this amendment you desire to change an offer already submitted, such change may be made by letter or fax, provided each letter or telegram makes reference to the solicitation and this amendment, and is received prior to the opening hour and date specified.					
12. Accounting and Appropriation Data (If Required)					
13. THIS ITEM APPLIES ONLY TO MODIFICATIONS OF CONTRACTS/ORDERS, IT MODIFIES THE CONTRACT/ORDER NO. AS DESCRIBED IN ITEM 14					
A. This change order is issued pursuant to: (Specify Authority)					
The changes set forth in Item 14 are made in the contract/order no. in item 10A.					
B. The above numbered contract/order is modified to reflect the administrative changes (such as changes in paying office, appropriation date, etc.) set forth in item 14, pursuant to the authority of 27 DCMR, Chapter 36, Section 3601.2.					
C. This supplemental agreement is entered into pursuant to authority of:					
D. Other (Specify type of modification and authority)					
E. IMPORTANT: Contractor <input type="checkbox"/> is not, <input checked="" type="checkbox"/> is required to sign this document and return <u>1</u> copy to the issuing office.					
14. Description of amendment/modification (Organized by UCF Section headings, including solicitation/contract subject matter where feasible.)					
Solicitation No. GF-2014-B-0218 for SEAS Laboratory Renovation Project, Building 32/42 - Storefront and Window Replacement is hereby amended as follows:					
1. Question and Answers (Attachment A)					
2. All other Terms and Conditions remain unchanged.					
Except as provided herein, all terms and conditions of the document referenced in Item (9A or 10A) remain unchanged and in full force and effect					
15A. Name and Title of Signer (Type or print)			16A. Name of Contracting Officer		
			Mary Ann Harris		
15B. Name of Contractor		15C. Date Signed	16B. District of Columbia		16C. Date Signed
			Mary Ann Harris		8/27/2014
(Signature of person authorized to sign)			(Signature of Contracting Officer)		

ATTACHMENT A

QUESTIONS AND ANSWERS

University of the District of Columbia
 SEAS Laboratory Renovation Project, Building 32/42 – Storefront and Window Replacement


Solicitation No. GF-2014-B-0218

Questions & Responses


1	<p>Please confirm if the windows on the west exterior wall of Bldg. 32, Level B are scheduled to be replaced (Sheet A-302a).</p>	<p>Confirmed.</p>
2	<p>Please confirm the extent of work at the following sides: Bldg. 32, Level 1, Level 2 Exterior North Wall. Bldg. 32, Level 1, Level 2 Exterior West Wall. Bldg. 32, Level 1, Level 2 Exterior South Wall. South Corridor between Bldg. 32 and 42, Level 1.</p>	<p>Refer to the Contract Documents for extent of work in the areas indicated.</p>
3	<p>The "PLAN CODED NOTES" on Sheets A-303a, A-304a and A-305a are not correlated with the scope of work. Please clarify.</p>	<p>The "PLAN CODED NOTES" on Sheets A-303a, A-304a and A-205a are the scope of work.</p>
4	<p>There was a discussion at the site visit to provide electrical outlets and data drops in a few class rooms. Please confirm / clarify in which classrooms this work needs to be done. Also provide us a quantity for each of the items i.e. electrical outlets, data outlets etc.</p>	<p>Power and data drops are required as noted in Plan Coded Notes 4, Sheets A302a & A-303a and in Plan Coded Notes 3, Sheets A-304a & A-305a: <i>"Remove and provide new laboratory bench tops at the perimeter window locations in Rooms 32-A01, 32-A02 & 32-101."</i></p> <p>Data, power, and work surfaces shall be provided to replace the Data, power and work surfaces removed as part of the effort to Replace the Windows. In some cases equipment and power are fastened directly to the mullions which will have to be removed. Currently the areas operate desktop workstations and electrical controls equipment for instructional purposes.</p> <p>Specifically: 32/A01: Provide (9) Power Strips off (2) disconnect switches with (4) 15A breakers each. Re-use existing electrical wiring and power as applicable.</p>

University of the District of Columbia
SEAS Laboratory Renovation Project, Building 32/42 – Storefront and Window Replacement

Solicitation No. GF-2014-B-0218

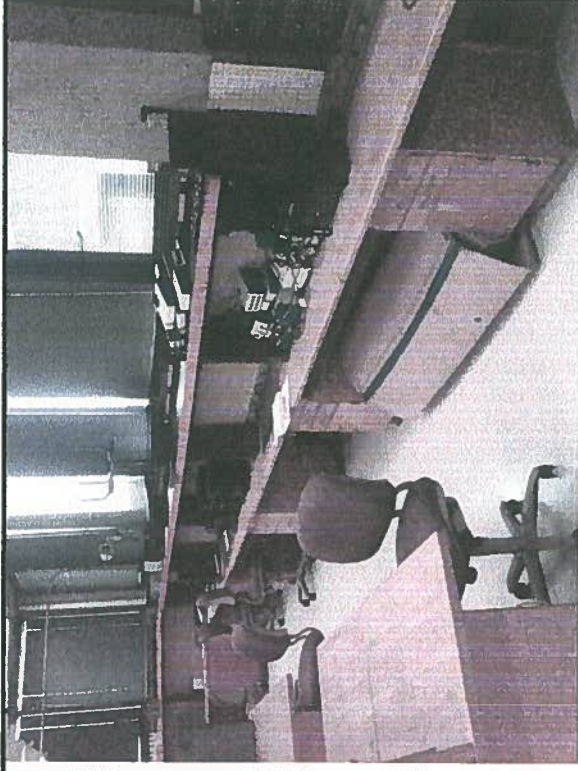


32/A02: Provide 2-Sets of (4) 120/240 V 20A Duplex Outlets five-feet on center. Provide (4) Data ports five-feet on center next to outlets.

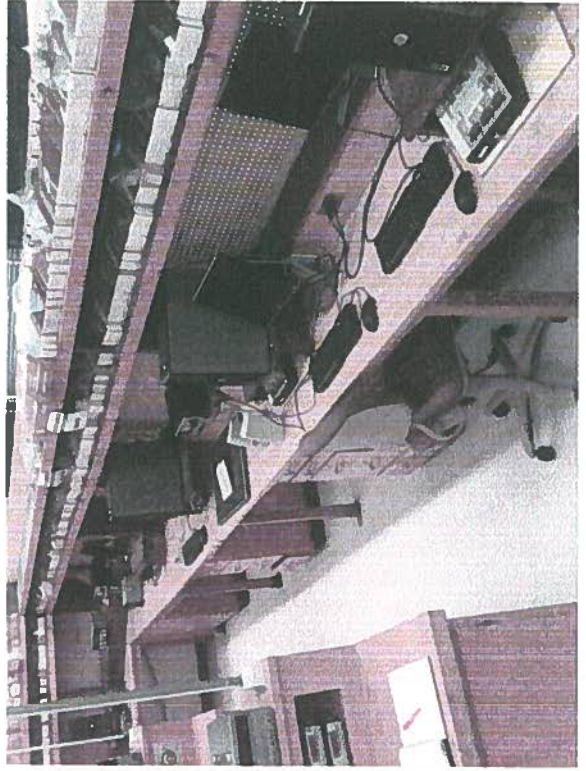

University of the District of Columbia
 SEAS Laboratory Renovation Project, Building 32/42 – Storefront and Window Replacement

Solicitation No. GF-2014-B-0218

	<p>32/102: Provide (3) 120/240 V 20A Duplex Outlets five-feet on center. Provide (3) Data ports five-feet on center next to outlets.</p>  <p>Remove existing as required back to source. Install new as required from the source (i.e. electrical panel, IT switch, etc.). Reuse spare capacity made available by removal. If you are able to replace the windows without disturbing the existing equipment, then no additional work is required.</p>
<p>5 Please provide a window schedule that need new roller shades.</p>	<p>Refer to Sheet A-300a, modify General Note 30 as follows: “All Windows replaced as part of this project (new or existing) will be installed with manual roller shades.”</p> <ul style="list-style-type: none"> • For Plaza-Level Windows: Shades will extend to the bottom of the window sill. • For Windows with Concrete Spandrels: Shades will extend to the bottom of the window sill of the upper window. <p>The Contract Drawings indicates the windows to be replaced as part of this</p>

**University of the District of Columbia
SEAS Laboratory Renovation Project, Building 32/42 – Storefront and Window Replacement**

Solicitation No. GF-2014-B-0218

12	Who's responsible for testing and inspect from third party?	The Contractor awarded this project is required to provide all third-party testing.
13	Are power/water available on site? If so, who is paying for their usages?	Power and water are available on site and are available (within reason) for the purpose of performing construction activities, refer to the Division 01. Assuming this question is in reference to the window testing, it is recommended that the Contractor verify the necessary water and power connections for testing prior to scheduling their testing company. Usually when these logistics are not coordinated properly testing companies will leave and charge the Contractor for a second visit due to inadequate preparations.